 EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31228		
	SPECIFICATION	Edition	4	Page

ECS - INDUSTRIAL CONTROL SWITCH SELECTOR

1. FEATURES

- Up to 5 different operations.
- Detachable contact block for easy installation and removal. It can meet variety of needs and improve work efficiency.
- IP65 waterproof type. It is designed for liquid and oil prevention and enables to be used in different environment.
- In accordance with the standards of UL, cUL, CE, CCC, and TUV.

2. SPECIFICATIONS

2-1. ELECTRICAL

2-1-1. Rated thermal current	10A
2-1-2. Rated insulation voltage	650V
2-1-3. Utilization category	AC-15(A600) or Ue 240V / Ie 3A Ue 380V / Ie 1.9A DC-13(P600) or Ue 250V / Ie 0.55A
2-1-4. Minimum switching capacity [ref.]	3V DC/AC, 5mA
2-1-5. Dielectric strength	2500V AC, 1 min.
2-1-6. Insulation resistance	100MΩ min. at 500V DC
2-1-7. Contact resistance	50mΩ max. (initial)


2-2. MECHANICAL AND ENVIRONMENTAL

2-2-1. Operating temperature	-25°C ~ +70°C (without icing or condensation) -25°C ~ +55°C (for illuminated type)
2-2-2. Storage temperature	-40°C ~ +85°C
2-2-3. Humidity	45% ~ 85% RH
2-2-4. Degree of protection	IP65 (from the front of the panel)
2-2-5. Degree of contamination	3 (IEC 60947-5-1)
2-2-6. Vibration resistance	10-55Hz single amplitude 0.5mm
2-2-7. Shock resistance	100 m/s ² (10G)(malfunction) 1000 m/s ² (100G)(destruction)
2-2-8. Mechanical Life	500,000 operations frequency 1800 operations/hr
2-2-9. Electrical Life	500,000 operations frequency 1800 operations/hr
2-2-10. Operation Force(from 1a1b)[ref.]	0.2 N-m (2- or 3- position type) 0.6 N-m (spring return type)
2-2-11. Connection type	M3.5 screw connection
2-2-12. Direct opening action	Direct opening mechanism of NC contact to open the circuit (→)

ECE	EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31228		
		Edition	4	Page	2

SPECIFICATION

3. CONSTRUCTION

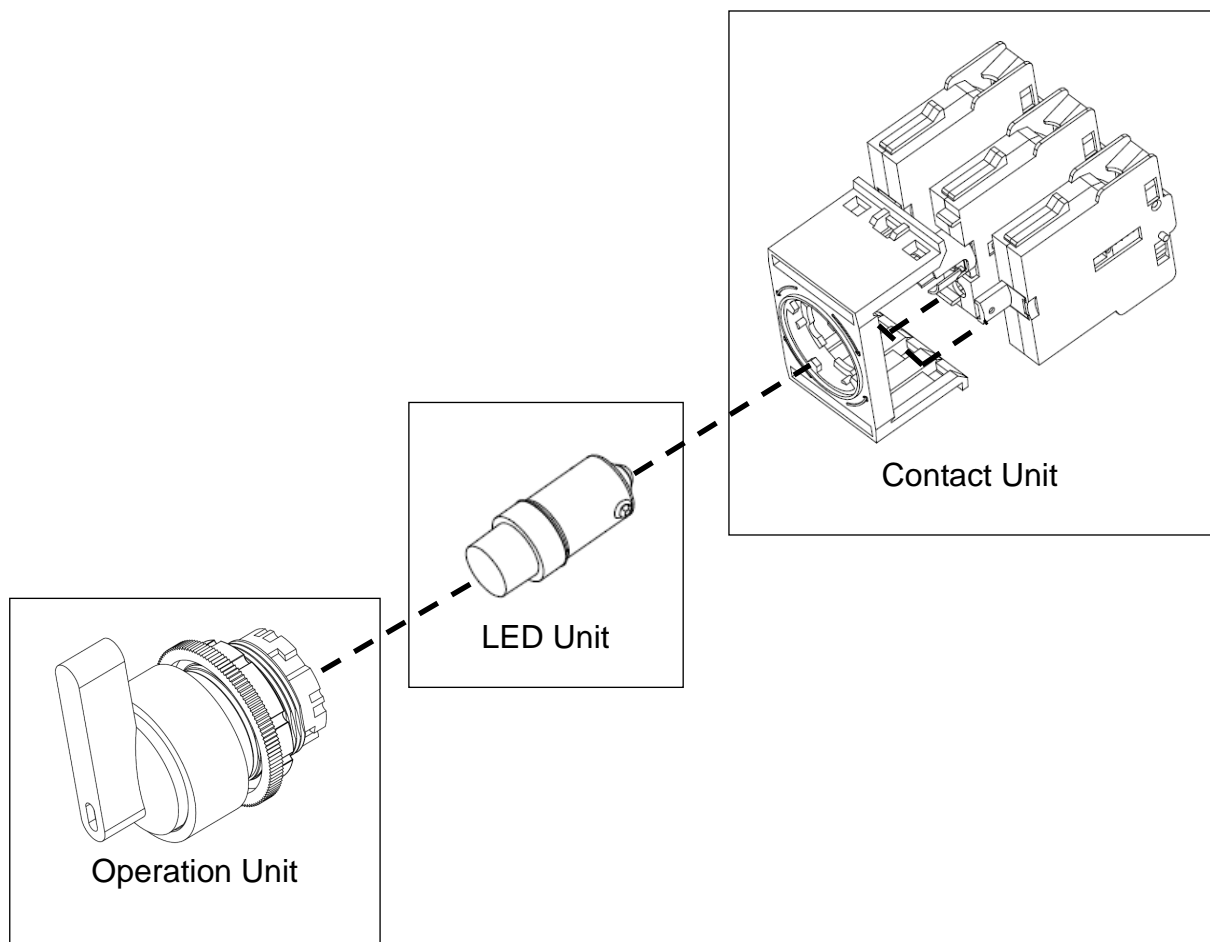


- Operation unit, LED unit, and contact unit (contact blocks) can be sold separately.
- Please see [4.Part numbering system] for operation unit part number. For other accessories (LED lamp, contact block, etc.), please refer to accessory part in catalog.



4. PART NUMBERING SYSTEM

ECS - XX X S 1 R X - XX X 0 X - L XX R

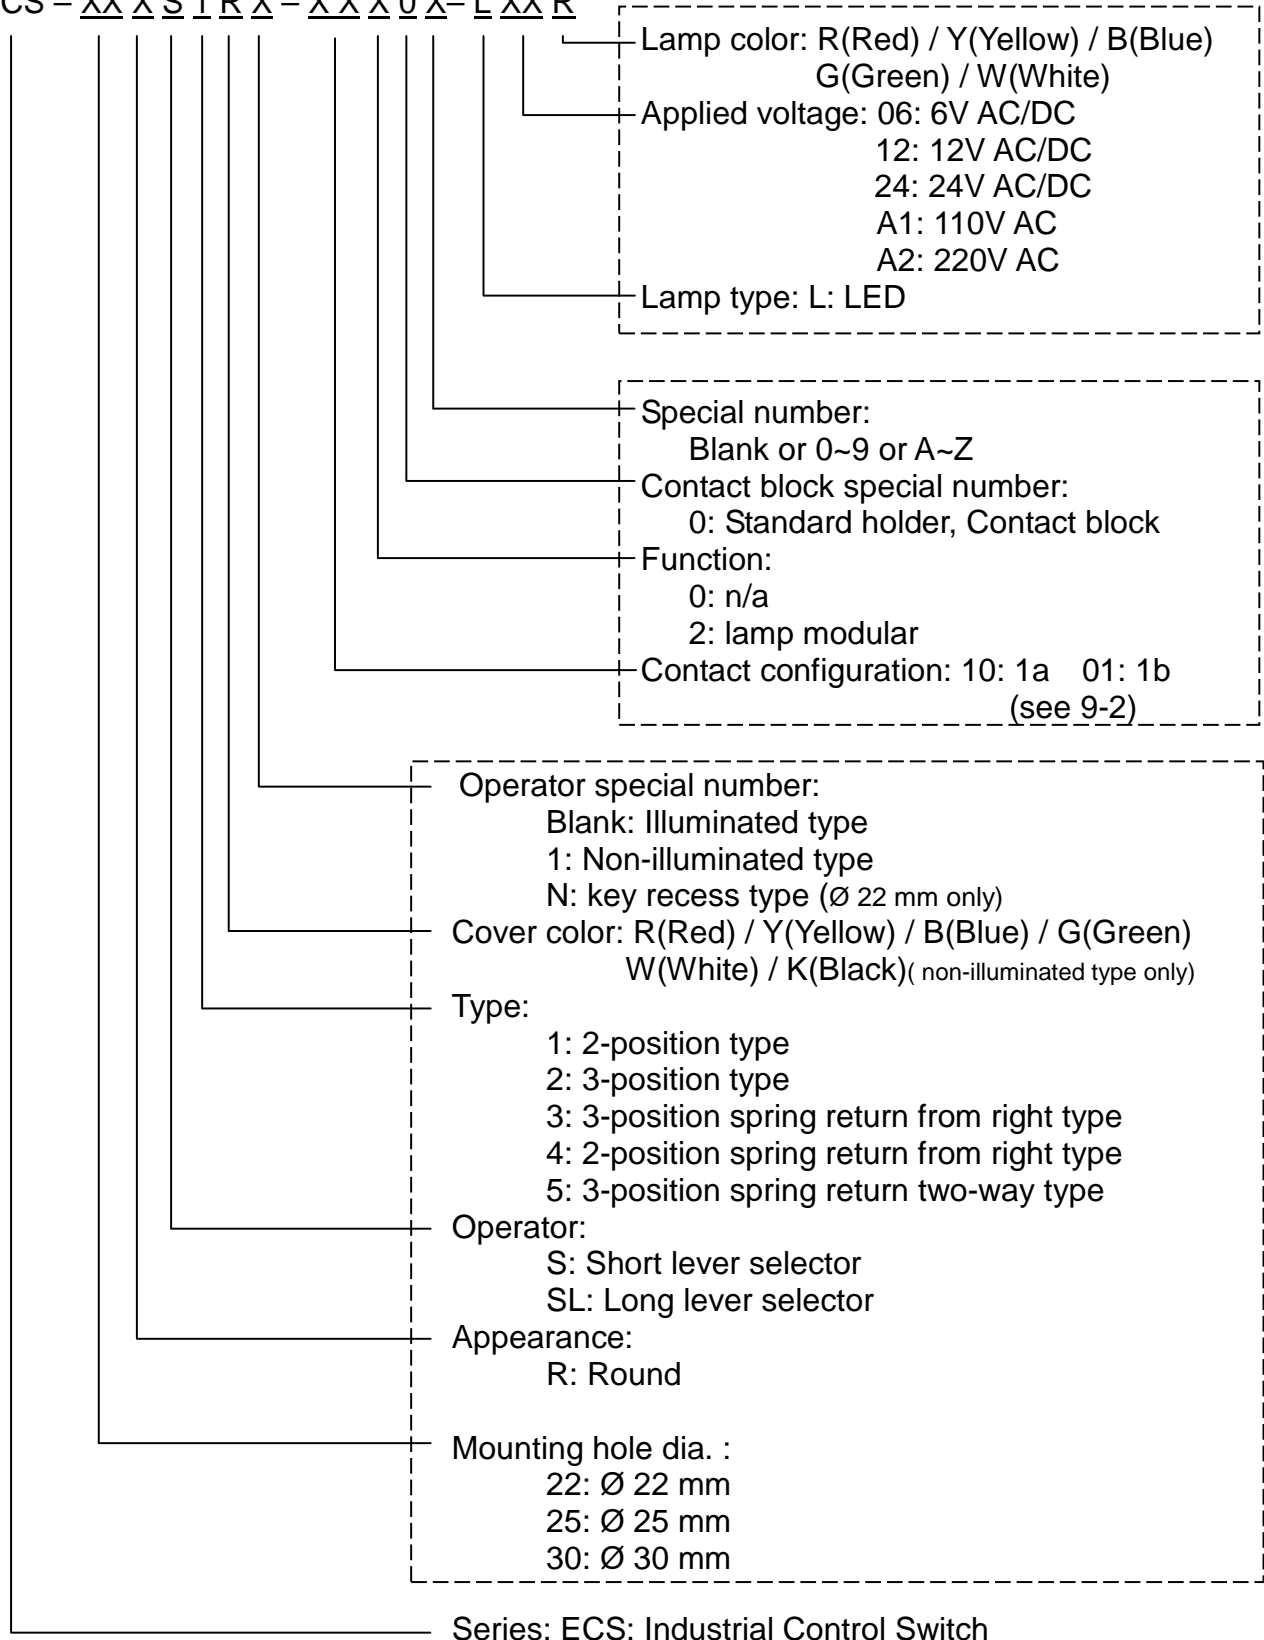

EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31228		
		4		
SPECIFICATION		4	Page	4


5. INSTALLATION

5-1. Panel thickness

- The panel thickness must be 1 to 7 mm.
- Take into consideration about the thickness of accessories (such as name plate, switch guard, etc.) while using.

5-2. Panel cutout

- Cutout diameter and distance




Unit: mm

	22R / 25R	22Q / 25Q	30R
A	22.3/25.3 ^{+0.4} / ₋₀	22.3/25. ^{+0.4} / ₋₀	30.5 ^{+0.5} / ₋₀

Unit: mm

	22R / 25R	22Q / 25Q	30R	Long Lever Selector Switch Emergency Stop Switch
X	30	32	50	50
Y	50	50	65	50

- Key recess cutout (Ø 22mm only)



Unit: mm


Mounting Hole(Ø)	a	b
22	24.1 ^{+0.5} / ₋₀	3.2 ^{+0.2} / ₋₀

- Panel installation


1. Place the operation unit through panel mounting hole.
2. Install the nut by using tightening tool.
3. Make sure the operation unit fix on the panel firmly.


5-3. Operation unit and contact unit installation

1. Fix the operation unit on the panel.
2. Connect the operation unit with snap-fit joint part of contact unit.
3. Rotate contact unit to fix firmly as shown in the left figure.

 EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31228		
	SPECIFICATION	Edition	4	Page

5-4. LED lamp installation

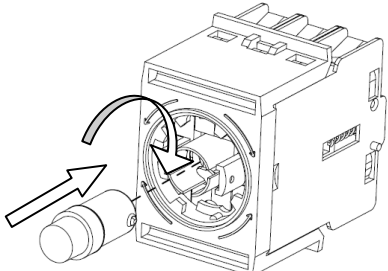	<ol style="list-style-type: none"> 1. Aim LED lamp to the lamp holder and press down to the bottom. 2. Rotate the LED lamp to make sure the lamp is firmly installed. 3. While installation and removal, please hold the metal part of LED lamp to avoid damaging LED lamp.
---	--

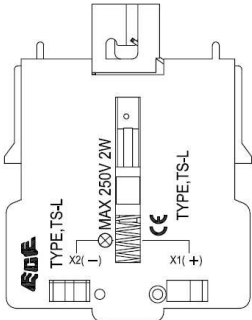	<ol style="list-style-type: none"> 1. When using DC LED lamp, please connect the positive pole (+) to X1 terminal as shown in left figure. 2. The LED lamp may be erroneously lightened by a leaking current from the circuit. The malfunction can be prevented by connecting a shunt resistor in parallel with the LED lamp.
--	---

6. PACKAGING

6.1. ECS product is packed without assembly (packed by set), 10 sets per box.

6.2. Label information

- | | |
|-------------------|-------------------------|
| (1) part number | (6) QC inspection stamp |
| (2) Lot number | (7) Company mark |
| (3) Quantity | (8) Company name |
| (4) Tester number | (9) Notice |
| (5) Date code | |

7. DIMENSIONS

7-1. See attached drawings

8. OPTIONS


8-1. Key recess type operation unit is available (Ø 22mm only)

8-2. Ø22mm and Ø25mm type have the same structure. Different thickness of O-rings can be ordered separately to fit into Ø22mm and Ø25mm hole in the panel.

8-3. LED Specification

LED Type	BA9S-T8
Durability(reference)	Approx. 50,000 Hrs.
Voltage	Printed on the LED

8-4. For other accessories (name plate, control box, and etc.), please refer to accessory part in the catalog.

 EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31228		
	SPECIFICATION	Edition	4	Page

9. REMARK

9-1. Safety Certification

Safety Standard	Certification
UL-508	UL / cUL , file NO. E155181
CSA C22.2 NO.14	
EN60947-5-1	R50363071
EN60947-5-5 (Emergency Stop Switch)	R50362996
CCC GB14048.5	CQC2016010305912684

9-2. Contact Configuration

Code	Contact blocks		without function block	with function block
	NO	NC		
10	1	0	●	●
01	0	1	●	●
11	1	1	●	●
20	2	0	●	●
02	0	2	●	●
12	1	2	●	●
21	2	1	●	●
30	3	0	●	●
03	0	3	●	●
31	3	1	●	●
13	1	3	●	●
22	2	2	●	●
40	4	0	●	●
04	0	4	●	●
41	4	1	●	/
14	1	4	●	
23	2	3	●	
32	3	2	●	
50	5	0	●	
05	0	5	●	




Remark:

- The colors of contact block are the followings: 1 NO: green, 1 NC: red
- Maximum 5 contact blocks for every contact unit.

9-3. CAUTION

- To prevent injury, this device must be disconnected from all power sources prior to wiring and other initiating work.
- Use tightening tool when installing the operation unit in the panel cutout. Do not use pliers and do not tighten excessively, otherwise the operation unit may be damaged.
- Make sure contact blocks are firmly fixed on contact holder during assembly. It will avoid contact blocks separated from holder during operation.

ECS-22RSXXX-XXX0

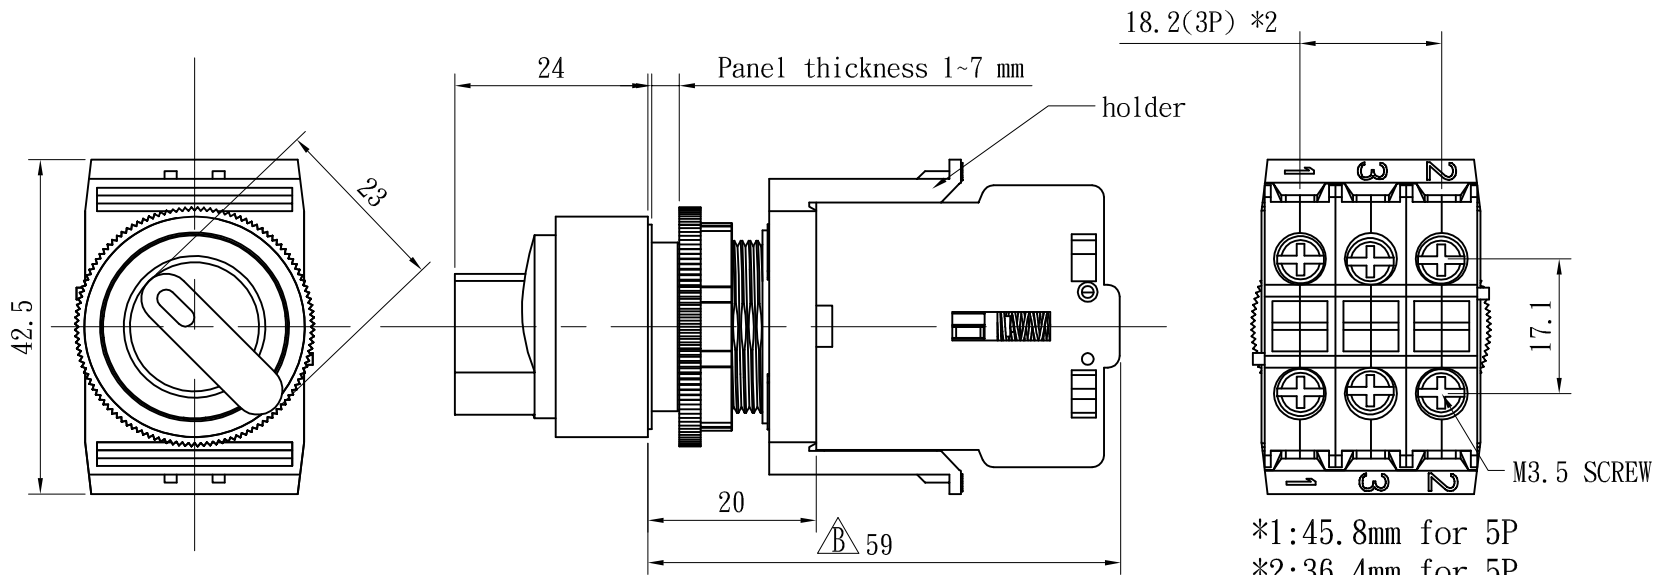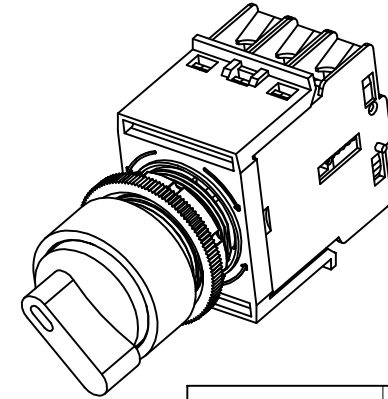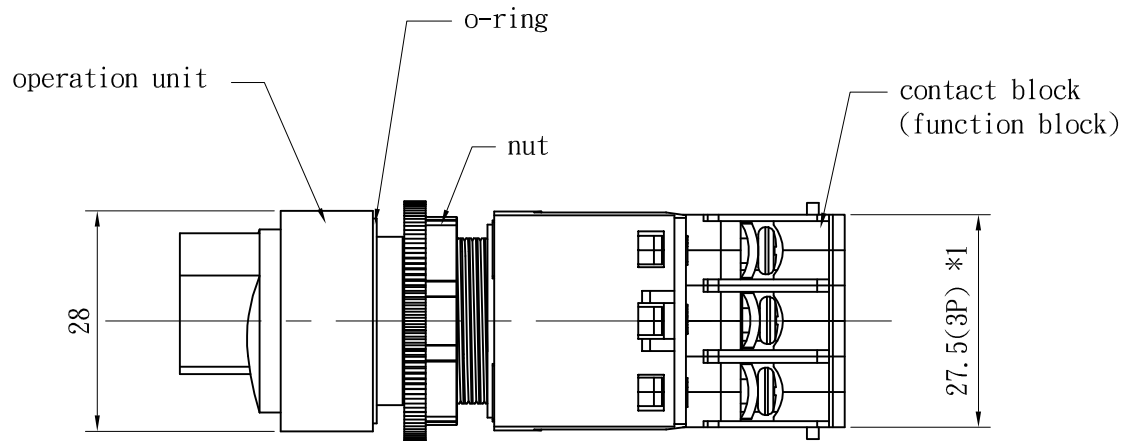

Operation	type	angle
2-position		90°
3-position		45°
3-position spring retrun form right		45°
2-position spring retrun form right		90°
3-position spring retrun form two-way		45°

*1:45.8mm for 5P
*2:36.4mm for 5P

				NORMAL TOLERANCE		ECEL EXCEL CELL ELECTRONIC CO., LTD.		PART NUMBER	
				RANGE	TOLERANCE			ECS-22RSXXX-XXX0	
				0-1	±0.1				
				1-4	±0.3				
				4-16	±0.5				
				16-63	±0.8				
				63-250	±1.0				
				X.	±5°				
				X.X	±2.5°				
						CHECK	Marcus Li	DESIGN	Alice Lin
								DRAWN	Alice Lin
								UNIT	MM (INCH)
								SCALE	1:1
								SIZE	A4
								PROJECTION	
								PART NAME	ECS
								TYPE	SELECTOR
								FILE NAME	76922RSXXB.DWG
								EDITION	B
NO.	DETAILS	ALTERED BY	DATE						



Marking position changes

Alice

2018/01/25

NO.

DETAILS

ALTERED BY

DATE



EXCEL CELL ELECTRONIC CO., LTD.

PART NUMBER

ECS-22RSXXX-XXX0

CHECK

Marcus Li

DESIGN

Alice Lin

DRAWN

Alice Lin





UNIT
SCALE
SIZE
PROJECTION

MM (INCH)
1:1
A4

PART NAME
TYPE
FILE NAME
EDITION

ECS
SELECTOR
76922RSXXB.DWG
B

ECS-22RSLXXX-XXX0

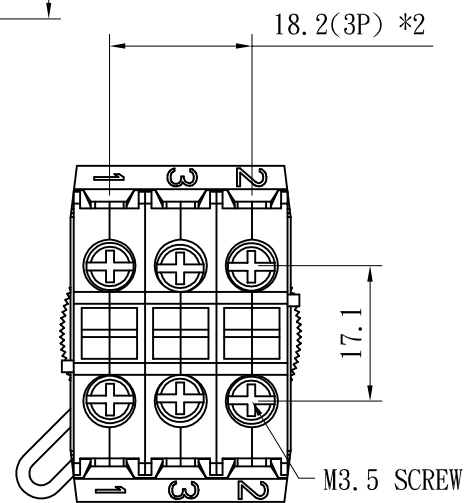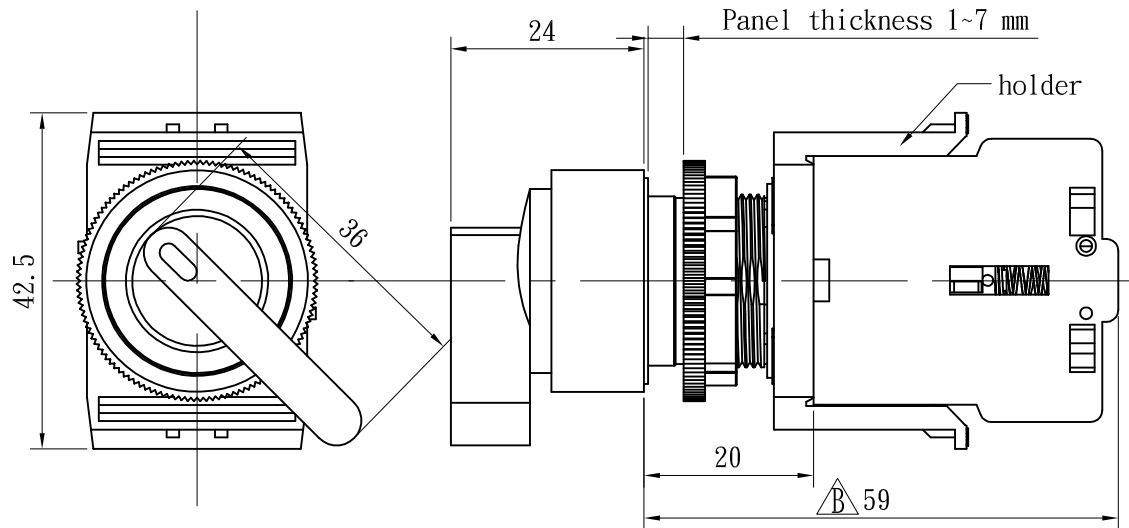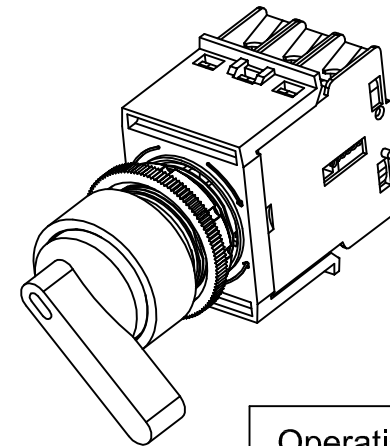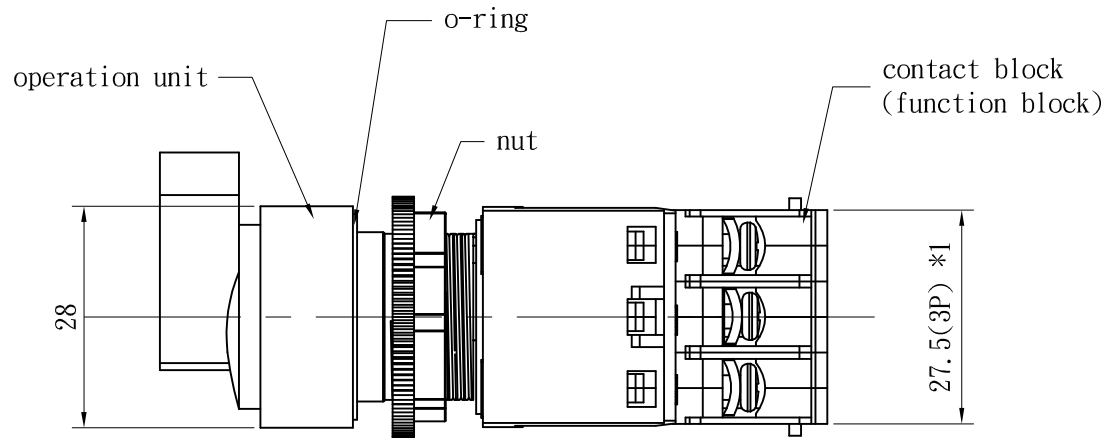

Operation	type	angle
2-position		90°
3-position		45°
3-position spring retrun form right		45°
2-position spring retrun form right		90°
3-position spring retrun form two-way		45°

*1:45.8mm for 5P

*2:36.4mm for 5P

NORMAL TOLERANCE	
RANGE	TOLERANCE
0-1	±0.1
1-4	±0.3
4-16	±0.5
16-63	±0.8
63-250	±1.0
X.	±5°
X.X	±2.5°



EXCEL CELL ELECTRONIC CO., LTD.

PART NUMBER

ECS-22RSLXXX-XXX0

NO.	DETAILS	ALTERED BY	DATE	CHECK	DESIGN	DRAWN	PROJECTION	UNIT	PART NAME
								MM (INCH)	ECS
					Marcus Li	Alice Lin	1:1 <td>TYPE</td> <td>SELECTOR</td>	TYPE	SELECTOR
						Alice Lin	A4 <td>FILE NAME</td> <td>76922RJXXB.DWG</td>	FILE NAME	76922RJXXB.DWG
								EDITION	B