

 EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31248		
	SPECIFICATION	Edition	3	Page

## ECS - INDUSTRIAL CONTROL SWITCH KEY SELECTOR

### 1. FEATURES

- Up to 5 different operations.
- Detachable contact block for easy installation and removal. It can meet variety of needs and improve work efficiency.
- IP65 waterproof type. It is designed for liquid and oil prevention and enables to be used in different environment.
- In accordance with the standards of UL, cUL, CE, CCC, and TUV.

### 2. SPECIFICATIONS

#### 2-1. ELECTRICAL


2-1-1. Rated thermal current	10A
2-1-2. Rated insulation voltage	650V
2-1-3. Utilization category	AC-15(A600) or Ue 240V / Ie 3A Ue 380V / Ie 1.9A DC-13(P600) or Ue 250V / Ie 0.55A
2-1-4. Minimum switching capacity [ref.]	3V DC/AC, 5mA
2-1-5. Dielectric strength	2500V AC, 1 min.
2-1-6. Insulation resistance	100MΩ min. at 500V DC
2-1-7. Contact resistance	50mΩ max. (initial)

#### 2-2. MECHANICAL AND ENVIRONMENTAL

2-2-1. Operating temperature	-25°C ~ +70°C (without icing or condensation)
	-25°C ~ +55°C (for illuminated type)
2-2-2. Storage temperature	-40°C ~ +85°C
2-2-3. Humidity	45% ~ 85% RH
2-2-4. Degree of protection	IP65 (from the front of the panel)
2-2-5. Degree of contamination	3 (IEC 60947-5-1)
2-2-6. Vibration resistance	10-55Hz single amplitude 0.5mm
2-2-7. Shock resistance	100 m/s <sup>2</sup> (10G)(malfunction) 1000 m/s <sup>2</sup> (100G)(destruction)
2-2-8. Mechanical Life	500,000 operations frequency 1800 operations/hr
2-2-9. Electrical Life	500,000 operations frequency 1800 operations/hr
2-2-10. Operation Force(from 1a1b)[ref.]	0.2 N-m (2- or 3- position type) 0.6 N-m (spring return type)
2-2-11. Connection type	M3.5 screw connection
2-2-12. Direct opening action	Direct opening mechanism of NC contact to open the circuit (→)

<b>ECE</b>	EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31248		
		Edition	3	Page	2
SPECIFICATION					

### 3.CONSTRUCTION

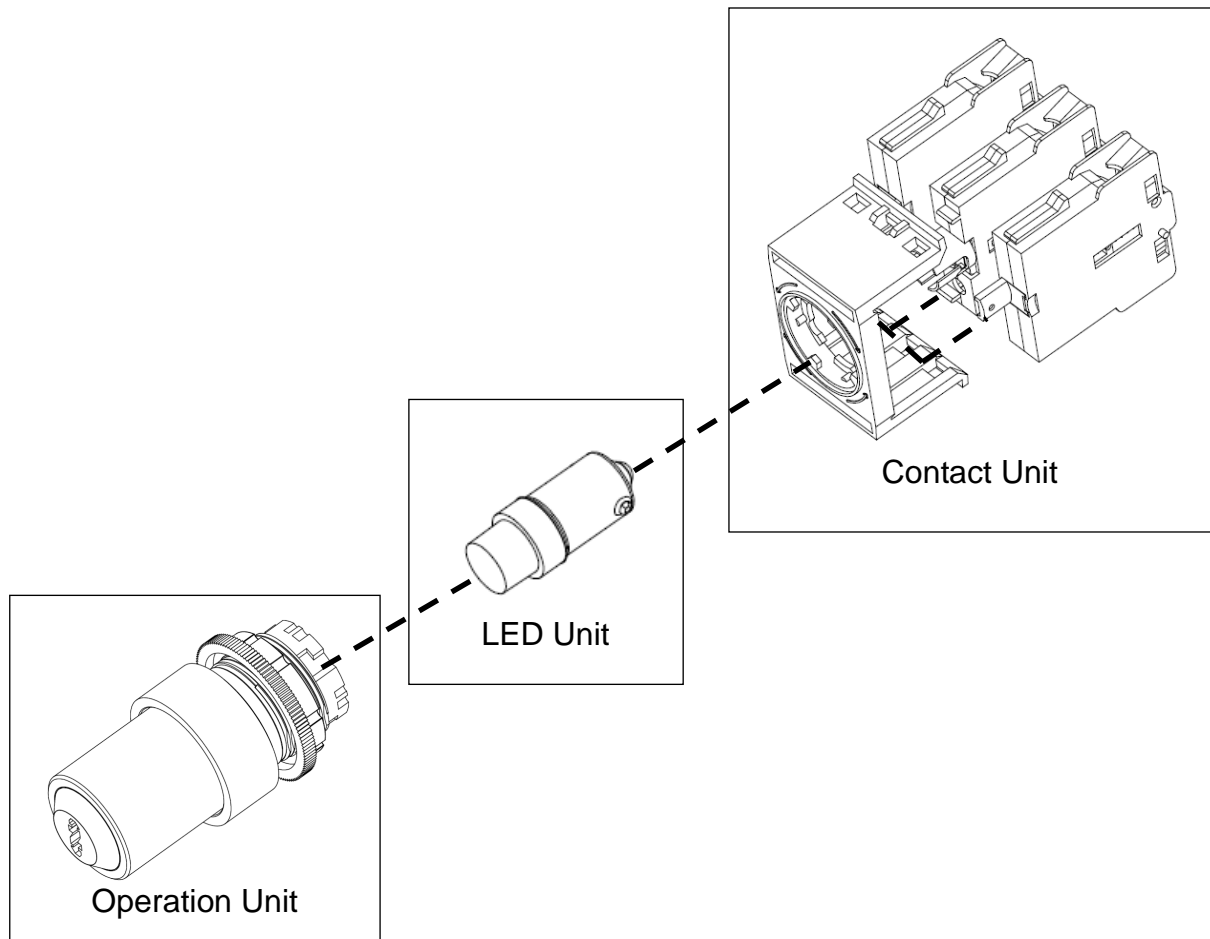



- Operation unit, LED unit, and contact unit (contact blocks) can be sold separately.
- Please see [4.Part numbering system] for operation unit part number. For other accessories (LED lamp, contact block, etc.), please refer to accessory part in catalog.



## 4. PART NUMBERING SYSTEM

ECS - XX R K X R X - XXX 0 X - L XX R

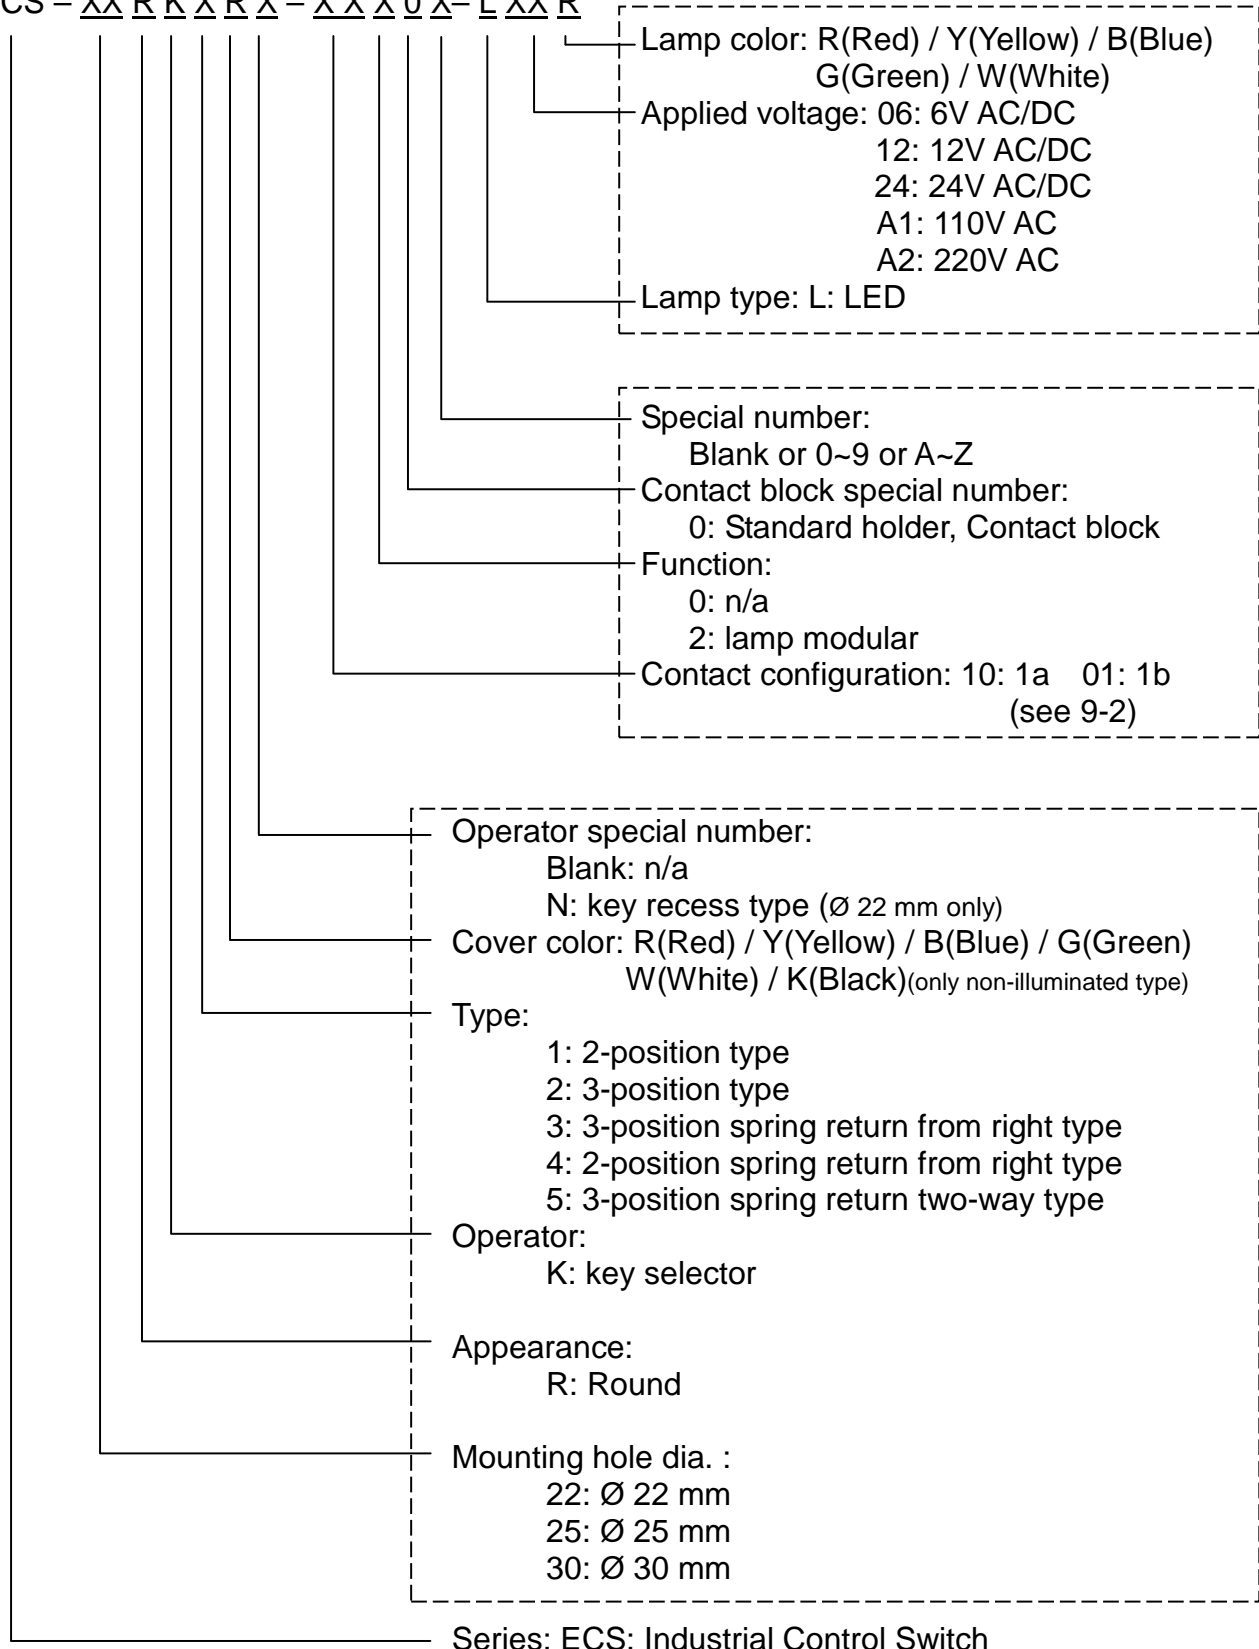

 <b>EXCEL CELL ELECTRONIC CO., LTD.</b>	<b>NO.</b>	<b>A31248</b>			
	<b>SPECIFICATION</b>		<b>Edition</b>	<b>3</b>	<b>Page</b>


## 5. INSTALLATION

### 5-1. Panel thickness

- The panel thickness must be 1 to 7 mm.
- Take into consideration about the thickness of accessories (such as name plate, switch guard, etc.) while using.

### 5-2. Panel cutout

- Cutout diameter and distance




Unit: mm

	22R / 25R	22Q / 25Q	30R
A	22.3/25.3 <sup>+0.4</sup> / <sub>-0</sub>	22.3/25.3 <sup>+0.4</sup> / <sub>-0</sub>	30.5 <sup>+0.5</sup> / <sub>-0</sub>

Unit: mm

	22R / 25R	22Q / 25Q	30R	Long Lever Selector Switch Emergency Stop Switch
X	30	32	50	50
Y	50	50	65	50

- Key recess cutout (Ø22mm only)



Unit: mm


Mounting Hole(Ø)	a	b
22	24.1 <sup>+0.5</sup> / <sub>-0</sub>	3.2 <sup>+0.2</sup> / <sub>-0</sub>

- Panel installation


1. Place the operation unit through panel mounting hole.
2. Install the nut by using tightening tool.
3. Make sure the operation unit fix on the panel firmly.


### 5-3. Operation unit and contact unit installation

1. Fix the operation unit on the panel.
2. Connect the operation unit with snap-fit joint part of contact unit.
3. Rotate contact unit to fix firmly as shown in the left figure.

 EXCEL CELL ELECTRONIC CO., LTD.	NO.	A31248		
	SPECIFICATION	Edition	3	Page

#### 5-4. LED lamp installation

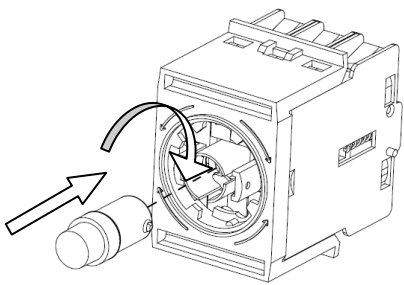	<ol style="list-style-type: none"> <li>1. Aim LED lamp to the lamp holder and press down to the bottom.</li> <li>2. Rotate the LED lamp to make sure the lamp is firmly installed.</li> <li>3. While installation and removal, please hold the metal part of LED lamp to avoid damaging LED lamp.</li> </ol>
-----------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

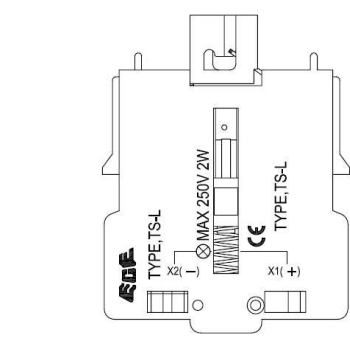	<ol style="list-style-type: none"> <li>1. When using DC LED lamp, please connect the positive pole (+) to X1 terminal as shown in left figure.</li> <li>2. The LED lamp may be erroneously lightened by a leaking current from the circuit. The malfunction can be prevented by connecting a shunt resistor in parallel with the LED lamp.</li> </ol>
------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

#### 6. PACKAGING

6-1. ECS product is packed without assembly (packed by set), 10 sets per box.

##### 6-2. Label information

- |                   |                         |
|-------------------|-------------------------|
| (1) part number   | (6) QC inspection stamp |
| (2) Lot number    | (7) Company mark        |
| (3) Quantity      | (8) Company name        |
| (4) Tester number | (9) Notice              |
| (5) Date code     |                         |

#### 7. DIMENSIONS

7-1. See attached drawings

#### 8. OPTIONS


8-1. Key recess type operation unit is available (Ø 22mm only)

8-2. Ø22mm and Ø25mm type have the same structure. Different thickness of O-rings can be ordered separately to fit into Ø22mm and Ø25mm hole in the panel.

##### 8-3. LED Specification

LED Type	BA9S-T8
Durability(reference)	Approx. 50,000 Hrs.
Voltage	Printed on the LED

8-4. For other accessories (name plate, control box, and etc.), please refer to accessory part in the catalog.

 <b>EXCEL CELL ELECTRONIC CO., LTD.</b>	<b>NO.</b>	<b>A31248</b>		
	<b>SPECIFICATION</b>	<b>Edition</b>	<b>3</b>	<b>Page</b>

9. REMARK

9-1. Safety Certification

Safety Standard	Certification
UL-508	UL / cUL , file NO. E155181
CSA C22.2 NO.14	
EN60947-5-1	R50363071
EN60947-5-5 (Emergency Stop Switch)	R50362996
CCC GB14048.5	CQC2016010305912684

9-2. Contact Configuration

Code	Contact blocks		without function block	with function block
	NO	NC		
10	1	0	●	●
01	0	1	●	●
11	1	1	●	●
20	2	0	●	●
02	0	2	●	●
12	1	2	●	●
21	2	1	●	●
30	3	0	●	●
03	0	3	●	●
31	3	1	●	●
13	1	3	●	●
22	2	2	●	●
40	4	0	●	●
04	0	4	●	●
41	4	1	●	/
14	1	4	●	
23	2	3	●	
32	3	2	●	
50	5	0	●	
05	0	5	●	





Remark:

- The colors of contact block are the followings: 1 NO: green, 1 NC: red
- Maximum 5 contact blocks for every contact unit.

9-3. CAUTION

- To prevent injury, this device must be disconnected from all power sources prior to wiring and other initiating work.
- Use tightening tool when installing the operation unit in the panel cutout. Do not use pliers and do not tighten excessively, otherwise the operation unit may be damaged.
- Make sure contact blocks are firmly fixed on contact holder during assembly. It will avoid contact blocks separated from holder during operation.

# ECS-22RKXX-XXX0

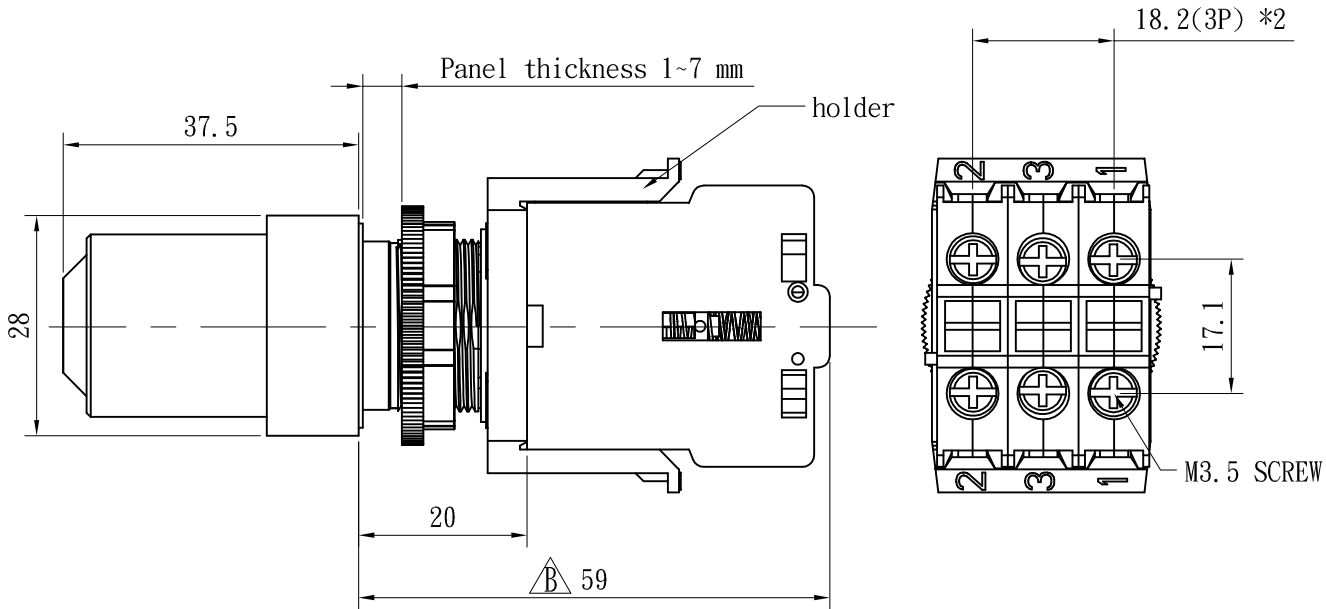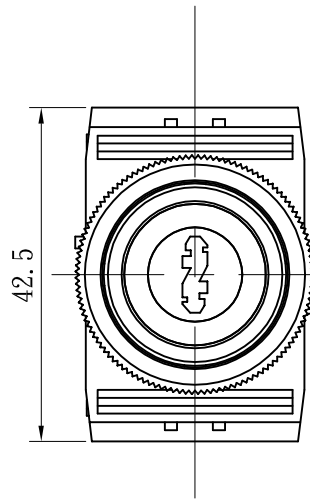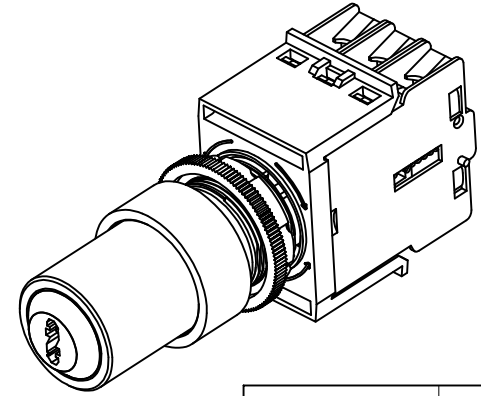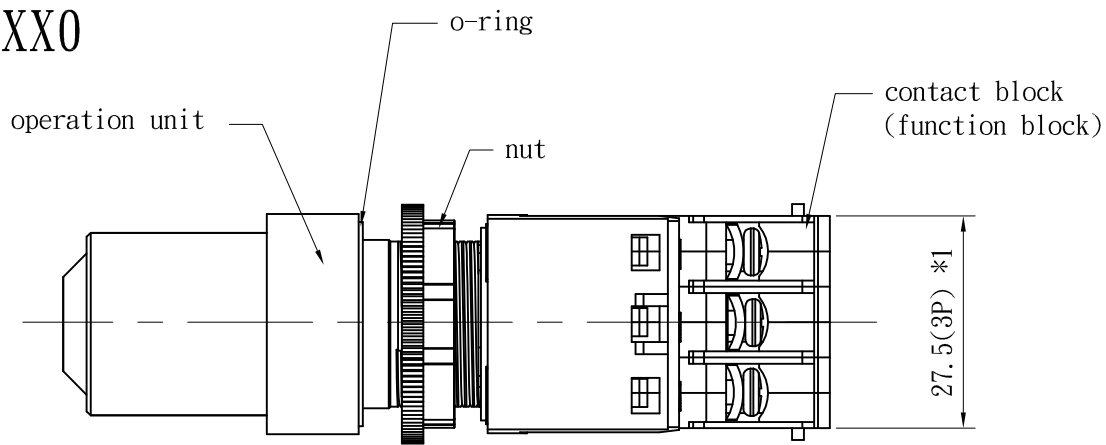

Operation	type	angle
2-position		90°
3-position		45°
3-position spring retron form right		45°
2-position spring retron form right		90°
3-position spring retron form two-way		45°

\*1:45.8mm for 5P  
\*2:36.4mm for 5P

				NORMAL TOLERANCE		EXCEL CELL ELECTRONIC CO., LTD.				PART NUMBER		ECS-22RKXX-XXX0											
				RANGE	TOLERANCE	CHECK	DESIGN	DRAWN	UNIT	MM (INCH)	PART NAME	ECS	TYPE	KEY SELECTOR									
				0-1	±0.1										Alice	Li	Alice	Lin	1:1	FILE NAME	76922RKXXB.DWG	EDITION	B
				1-4	±0.3																		
				4-16	±0.5																		
				16-63	±0.8																		
				63-250	±1.0																		
				X.	±5°	ALTERED BY	DATE	PROJECTION															
				X.X	±2.5°																		
NO.	DETAILS	Alice	2018/01/25																				



Marking position changes

Alice

2018/01/25

NO.

DETAILS

ALTERED BY

DATE



EXCEL CELL ELECTRONIC CO., LTD.

PART NUMBER

ECS-22RKXX-XXX0

CHECK

Marcus Li

DESIGN

Alice Lin

DRAWN


Alice Lin

UNIT  
SCALE  
SIZE

MM (INCH)  
1:1  
A4

PART NAME  
TYPE  
FILE NAME

ECS  
KEY SELECTOR  
76922RKXXB.DWG



EDITION

B